
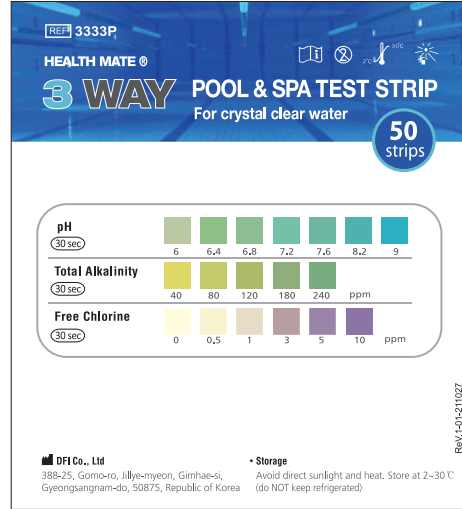


Water Test

Reagent Strip for Pool&Spa Water Test

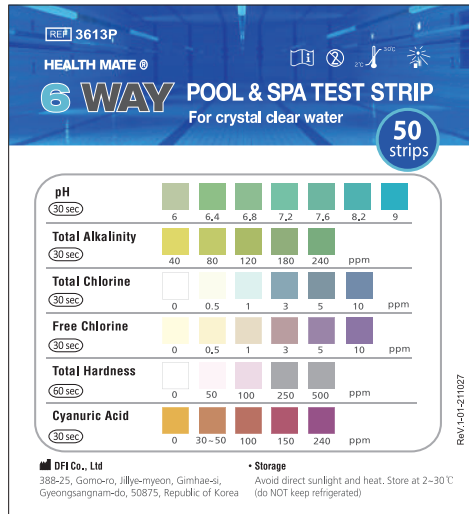

BACKGROUND

It is important to test your pool or spa often to keep the water clean and maintain your pool and its equipment.
 Test at least twice a week is highly recommended.

POOL & SPA WATER TEST FACTORS AND ACCEPTABLE VALUES

- pH (7.2 - 7.6)
- Total Alkalinity (80 - 120 ppm)
- Free Chlorine (1 - 4 ppm)
- Total Chlorine (1 - 4 ppm)
- Total Hardness (200 - 500 ppm)
- Cyanuric Acid (30 - 50 ppm)

****NOTICE****

These values are reported with a reference to CDC (Centers of Diseases Control and Prevention) guideline. Therefore, all values may vary.

NAME	1	2	3	4	5	6
HEALTH MATE® 6Way POOL & SPA TEST STRIP	P	TA	FC	TC	TH	CA
HEALTH MATE® 3Way POOL & SPA TEST STRIP	P	TA	FC			

P: pH, TA: Total Alkalinity, FC: Free Chlorine, TC: Total Chlorine, TH: Total Hardness, CA: Cyanuric Acid

